

Heater actuators - Series **MX**

HMG 4
HME 4

HMG 4




- 1 LEDs on = channels **H1 ... H4** switched on
- 2 Programming key and LED for physical address
- 3 Bus connection: Ensure correct polarity!
- 4 Manual selector switch: e.g. Permanently On / Off or Bus

HME 4

- 5 Plug as connection between upgrade module and basic device
- 6 LEDs on = channels **H1 ... H4** switched on
- 7 Manual selector switch: e.g. Permanently On / Off or Bus

Manual selector switch permanently - ON / OFF – Bus operation

Manual switch in position:

-  The status of the triac is determined by the bus messages.
-  The triac is permanently **switched on**.
-  The triac is permanently **switched off**.


Please note: Manual switching can also be used in the event of a bus voltage failure.

3.0. Electrical connection

The bus line must be routed, connected and installed in accordance with the valid regulations to DIN-VDE and also the EIB Handbook and ZVEI/ ZVEH. The work may be carried out only by trained electricians qualified to EIB.

Compliance with the national regulations and valid safety requirements is required. Tampering with or making modifications to the device will invalidate the warranty.

Connection for actuators HMG 4 and HME 4

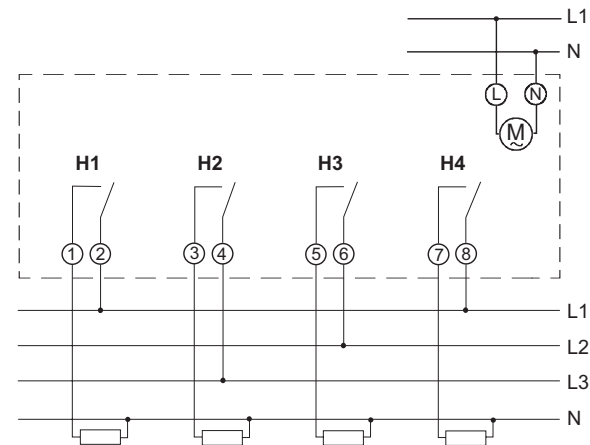

 **Please note:**

- It is permitted to connect different phases in one device.
- It is possible to connect contactable protective low voltage, if all 4 channels of a module switch protective low voltage.
- Switching protectors can be activated for controlling electric heaters, for example.

1.0 Designated use

The heater actuators for the series **MX** are as follows:

- **BMG 4** (4-channel basic module) and
- **HME 4** (4-channel upgrade module)

for controlling the heating valves via silent triac outputs.

The heater actuators are suitable for use with the European Installation - Bus **EIB KNX** in combination with the **theben** product database. ETS (EIB Tool Software) enables application programs to be selected, and specific parameters and addresses to be assigned and transferred to the device.

A type BCU 2.1 bus coupling is integrated into the basic modules. A basic module can be expanded simply by adding up to 2 upgrade modules. Any combination of **MX**-series modules is possible, e.g.

- HMG 4 + HME 4 + HME 4** (12 x heating)
- HMG 4 S + RME 4 S + RME 4 S** (4 x heating + 8 x switching)
- RMG 4 C-Last + DME 2 + HME 2** (4 x C-load + 2 x dimming + 4 x heating)
- etc.**

2.0 Description


- The device controls thermal actuators via silent and non-wearing triac outputs.
- The heating output can be continuously adjusted as and when required. This is achieved by converting a continuous control variable into a PWM (pulse width modulation) output signal.

Example:



HMG 4 Basic device

HME 4 Upgrade module

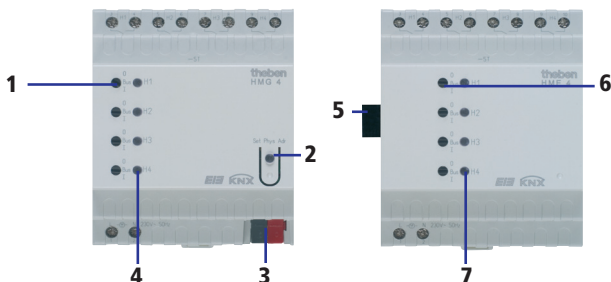

4.0 Bus connection / (mains) power failure

Information in the event of power failure

If the mains power should fail, all triacs switch-off, irrespective of the software configuration. This means that the power circuit is interrupted.

Information in the event of bus failure


- If a mains supply is available, the triacs can be operated using the manual switches should the bus fail.
- The behaviour after bus failure can be set via the application, e.g. emergency mode.

5.0 Connecting an upgrade module

- ☞ Open the slide on the right-hand side of the module.
- ☞ Lock the module onto the distributing bus bar.
- ☞ Push the modules fully together.

☞ Connection:

- ☞ Ensure correct polarity of the bus connection terminal.
Close the actuator as shown on the wiring diagram in Chapter 3.0.
The bus is connected to the basic module.

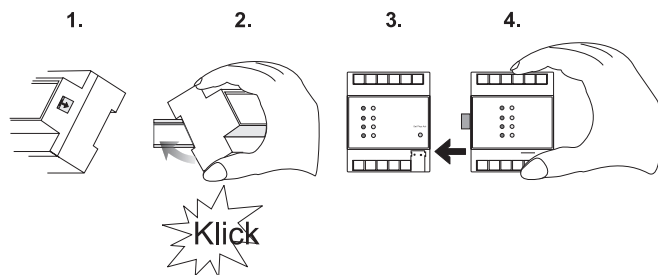

6.0 Technical data

HMG 4 / HME 4

Mains power supply

Operating voltage: 230 V AC \pm 10 %, 50 Hz
Power draw: 2.5 VA

Bus power supply

Power draw: max. 10 mA
Connection: bus terminal

Outputs

Quantity: 4
Type of contact: Triac
Nominal voltage: 24-230 V AC, 50 to 60 Hz (L1, L2 or L3)
Nominal current: 0.5 A
This corresponds to 5 x 24 V AC **theben** actuators (Order no. 907 0 262)

Switching of different phases: possible
Switching of SELV voltages: possible if all channels of a module switch protective low voltage

The device is suitable for use in conditions with a normal level of pollution. Observe deviating technical data on the device rating plate! Technical changes reserved. The devices comply with European Directives 73/23/EEC (low-voltage directive) and 89/336/EEC (EMC Directive).

If the devices are combined with others for use within a system, ensure that the system as a whole does not cause radio interference.

The ETS database can be found under www.theben.de
Please refer to the Handbook for detailed functional descriptions.

Theben AG

Hohenbergstr. 32
D-72401 Haigerloch
Germany
Phone +49 (0) 74 74/6 92-0
Fax +49 (0) 74 74/6 92-150

Service

Phone +49 (0) 74 74/6 92-369
Fax +49 (0) 74 74/6 92-207
hotline@theben.de

Addresses, telephone numbers etc. at
www.theben.de